



MONTHLY OPERATIONS REPORT

April 2018

Town of Discovery Bay, CA

3168 Days of Safe Operations

152,514 worked hours since last recordable incident

TRAINING: Safety, Operations, & Equipment

* TRAINING:

- • Safety
 - West Monthly Regional Safety Webinar
 - LOTO
 - Driving Safety
 - High Pressure Water Hydrant

- Operation
 - None this Month

REPORTS SUBMITTED TO REGULATORY AGENCIES

- * Monthly Discharge Monitoring Report (DMR)**
- * Monthly electronic State Monitoring Report (eSMR)**
- * Monthly Coliform Report, State Water Board (WD)**
- * Quarterly Discharge Monitoring Report (DMR)**
- * Quarterly Electronic State Monitoring Reports(eSMR)**
- * Quarterly Water Quality Report(DDW)**

WATER SERVICES

Groundwater Well:

- 1B - Active
- 2 – Active
- 4 – Active
- 5B - Active (Standby only)
- 6 – Active
- 7 - Active

2018 Water Production Table (MG) by Month


January	February	March	April	May	June
41	46	41	53		
July	August	September	October	November	December

Bacteriological Test Results

Routine Bacteria Samples Collected	No. Total Coliform Positives	No. Fecal/E. coli Positives	Brown Water Calls	Fire Hydrant Flushing
• 16	• 0	• 0	• 0	• 4


WATER USAGE

Water Production

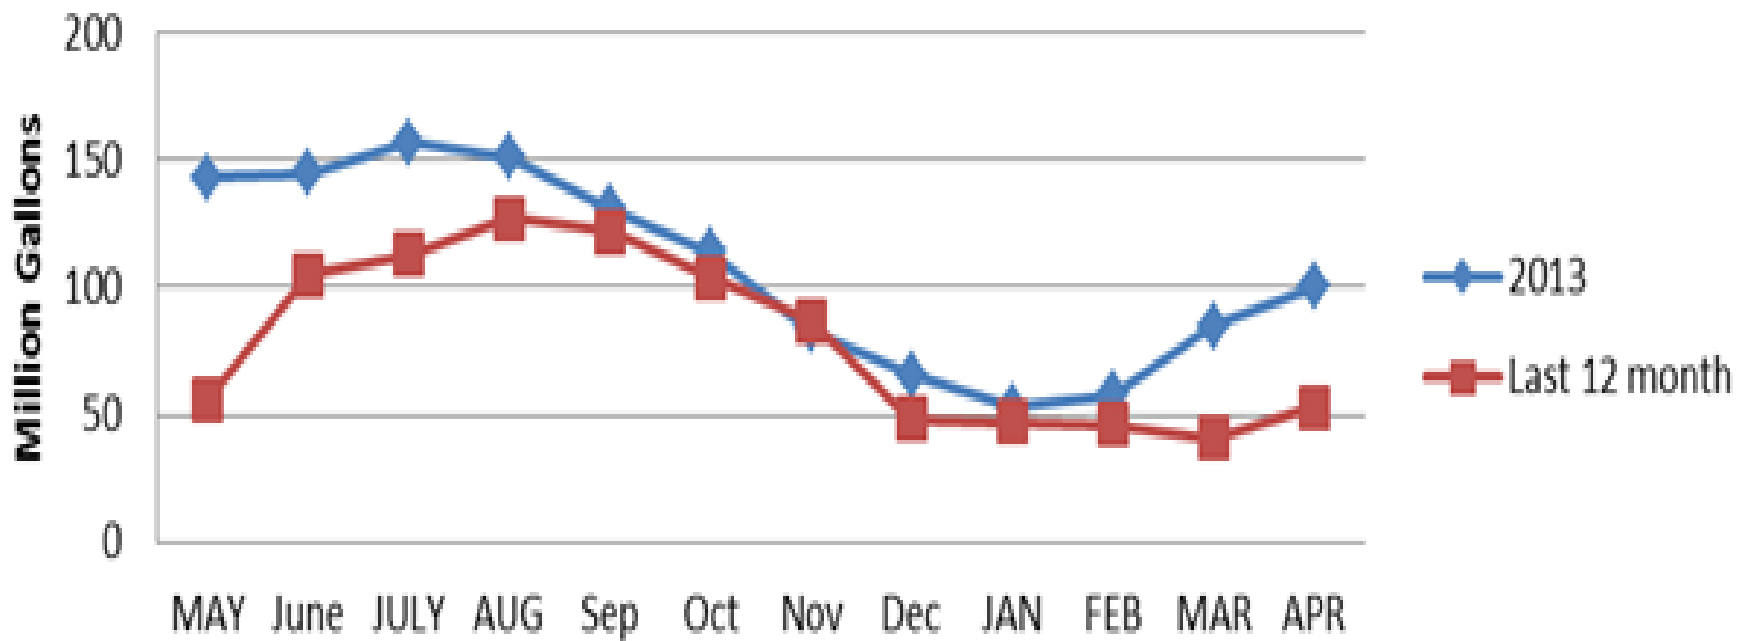


Water Saved

Reduction

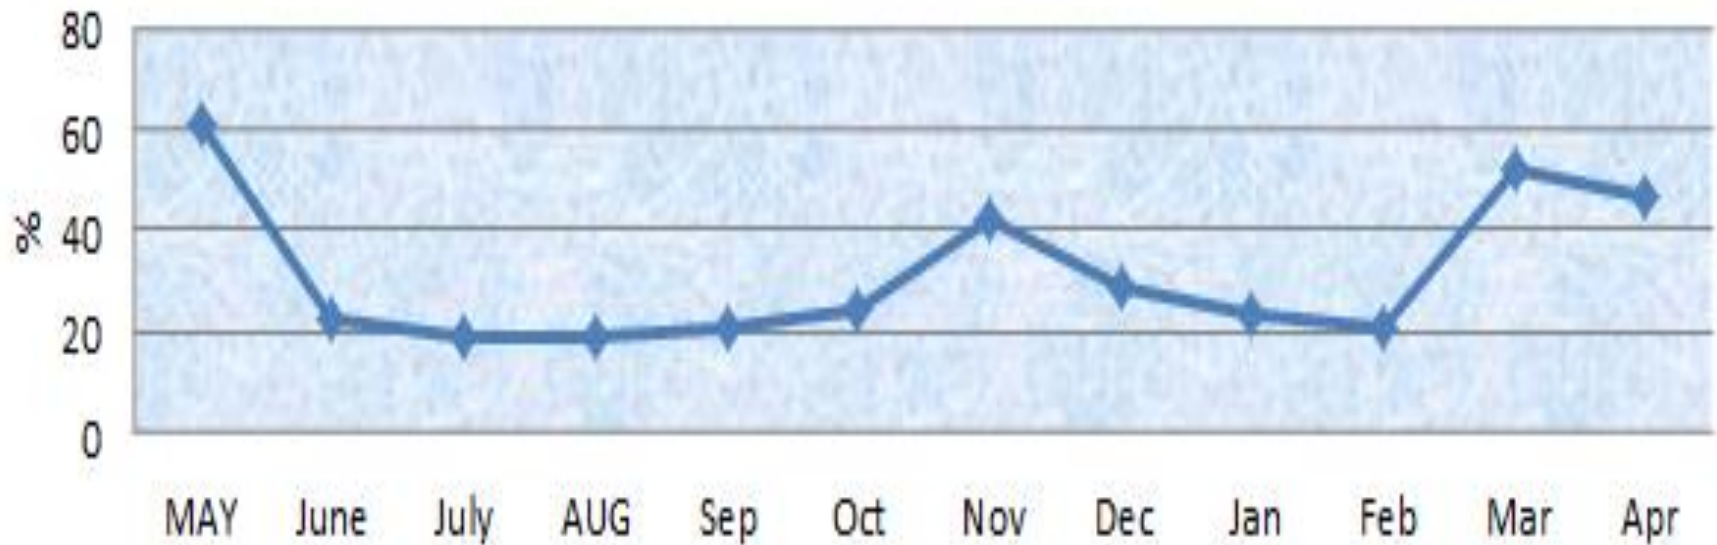

Chemical Usages

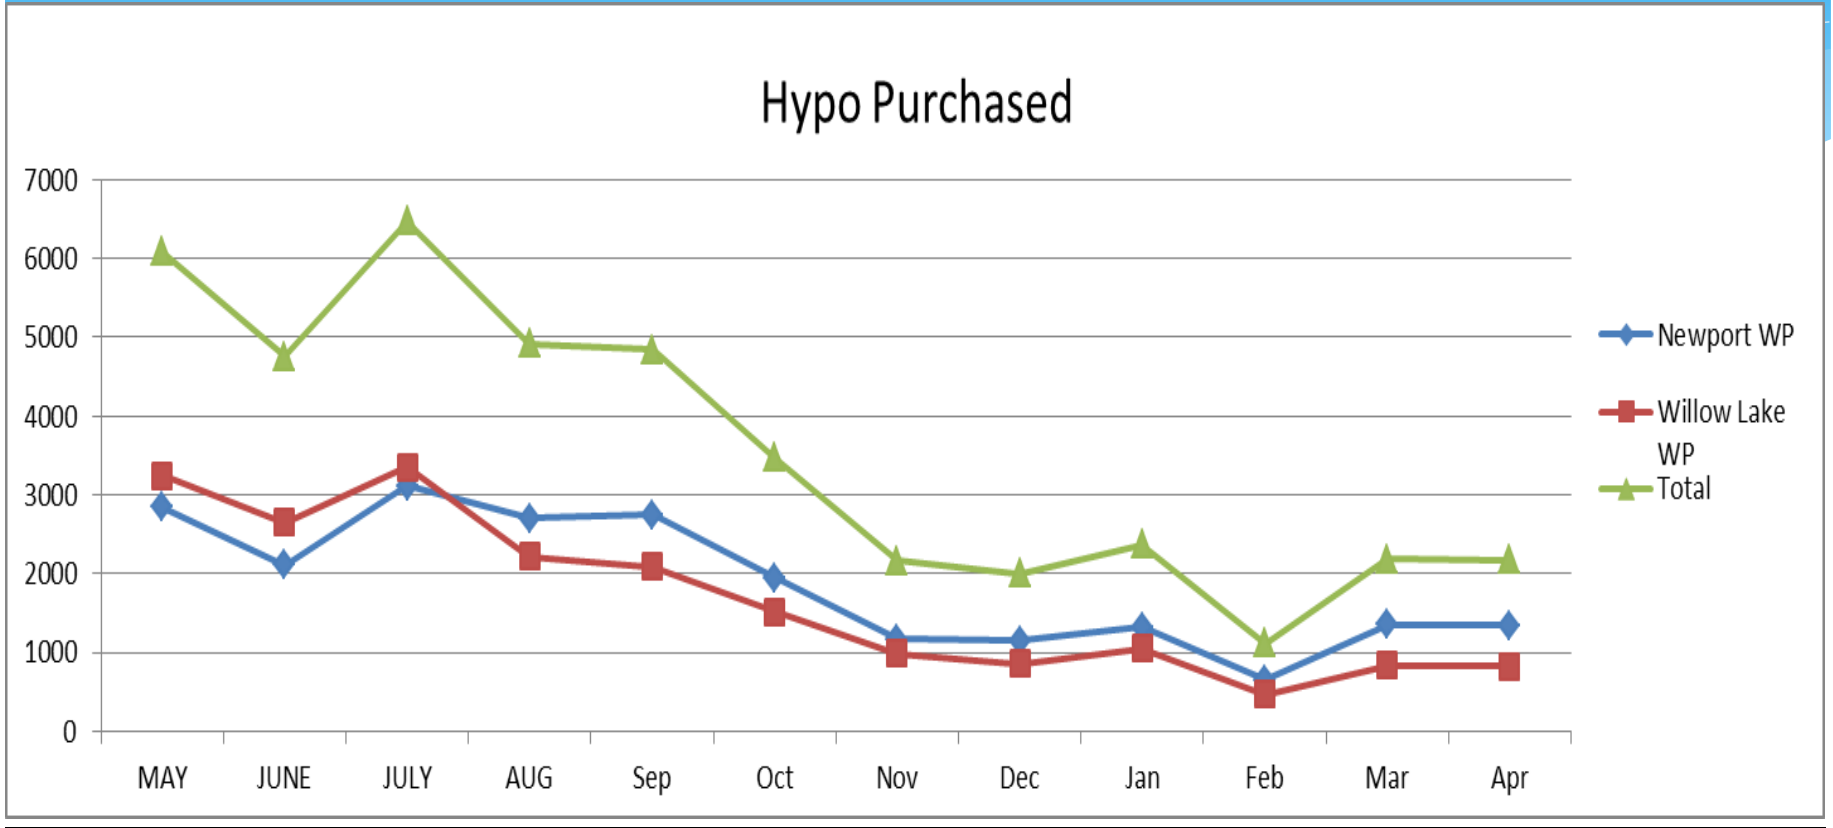

WASTEWATER SERVICE

Wastewater Laboratory Analysis

<i>WW Effluent Parameter</i>	<i>Permit Limits</i>	<i>Mar Lab Data</i>	<i>Apr Lab Data</i>
Flow, MG Effluent, monthly total	██████████	38	41
Flow, MG Daily Influent Flow, avg.	N/A	1.3	1.4
Flow, MG Daily Discharge Flow, avg.	2.1	1.3	1.1
Effluent BOD ₅ , lbs/d, monthly avg.	390	23	11
Effluent TSS, lbs/d, monthly avg.	200*	21	11
Effluent BOD ₅ , mg/L, monthly avg.	20	2	1
Effluent TSS, mg/L, monthly avg.	10*	2	1
Total Coli form 7 day Median Max	23	ND	ND
Total Coli form Daily Maximum	240	ND	ND
% Removal BOD ₅ , monthly avg.	85% min.	98	99
% Removal, TSS, monthly avg.	85% min.	98	99
Electrical Conductivity, umhos/cm annual avg.	2100	2130	2170

* New Limit

WASTEWATER SERVICE

* National Pollution Discharge Elimination System (NPDES)

NPDES Related Excursions	Permit Parameter	NPDES Parameter Limit	Actual Parameter Result
• 0	• N/A	• N/A	• N/A

COLLECTION:

# of Active Lift Stations	# of Inactive Lift Stations	SSO	Wastewater Received (MG)
15	0	0*	41

Force Main Vortex boxat Golf Station had a big rag ball that caused sewer to come out of top.

WASTEWATER SERVICE


- * 255,700 ft. of collection sewer line has been assessed
- * 400 ft. flushed/CCTV
- * 593 manhole & cover has been inspected
- * Performed weekly lift station inspections.

Maintenance

Preventive and Corrective



Work Order Back-Log

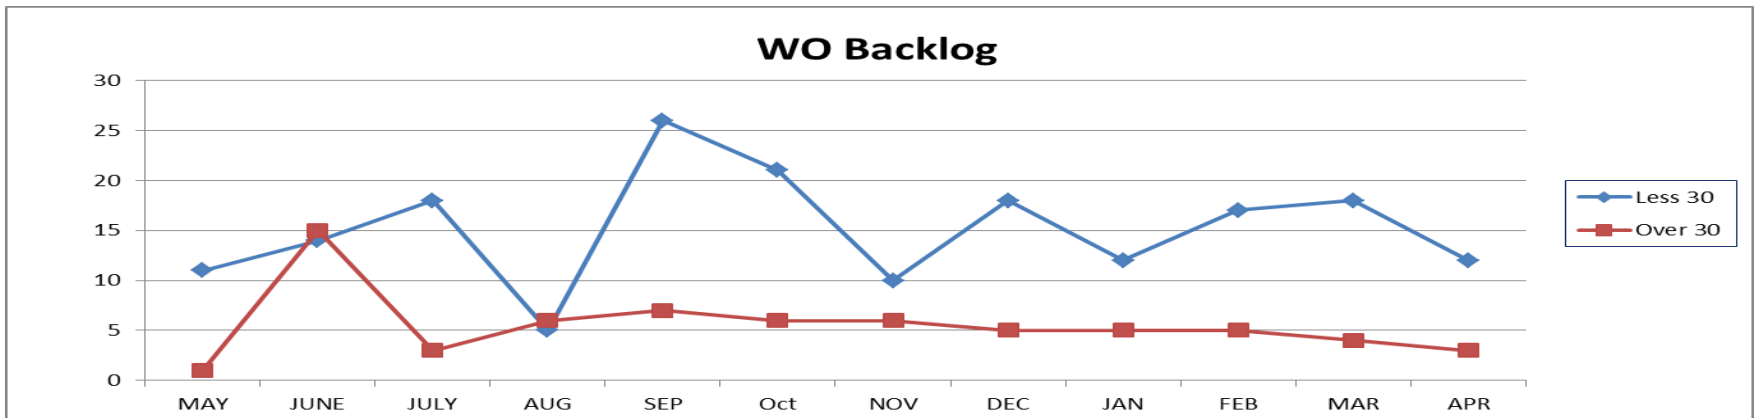

General Info

Call & Emergency Responses

Call Outs

3

Emergencies

0

Personnel Hours & Overtime:

Regular Hours

1582

Overtime

13

TERMS

WWTP	WASTEWATER TREATMENT PLANT
WTP	WATER TREATMENT PLANT
WL	WILLOW LAKE
NP	NEWPORT
VFD	VARIABLE FREQUENCY DRIVE
WO	WORK ORDER
PLC	PROGRAMMABLE LOGIC CONTROLLER
L/S	LIFT STATION
SSO	SANITARY SEWER OVERFLOW
BOD	BIOLOGICAL OXYGEN DEMAND
TSS	TOTAL SUSPENDED SOLIDS
MGD	MILLION GALLONS PER DAY
mg/l	MILLIGRAMS PER LITRE
CCTV	CLOSED CIRCUIT TELEVISION
PPM	PARTS PER MILLION
RAS	RETURN ACTIVATED SLUDGE
WAS	WATSE ACTIVATED SLUDGE
UV	ULTRAVIOLET LIGHT